


- ① RAIN SENSOR, REFER TO PLAN FOR SENSOR LOCATION
- ② VENT/DRY-OUT ADJUSTMENT
- ③ RAINFALL ADJUSTMENT
- ④ CONDUIT ADAPTER
- ⑤ 1/2" PVC WIRE CONDUIT; SEE NOTE 3



NOTES:

1. ALL ELECTRICAL WORK MUST CONFORM TO LOCAL CODES. REFER TO PRODUCT LITERATURE FOR ADDITIONAL INSTALLATION REQUIREMENTS.
2. MOUNT RAIN SENSOR TO LIGHT POLE, COORDINATE INSTALLATION WITH ELECTRICAL.
3. FOR CONDUIT AND WIRING, SEE ELECTRICAL.

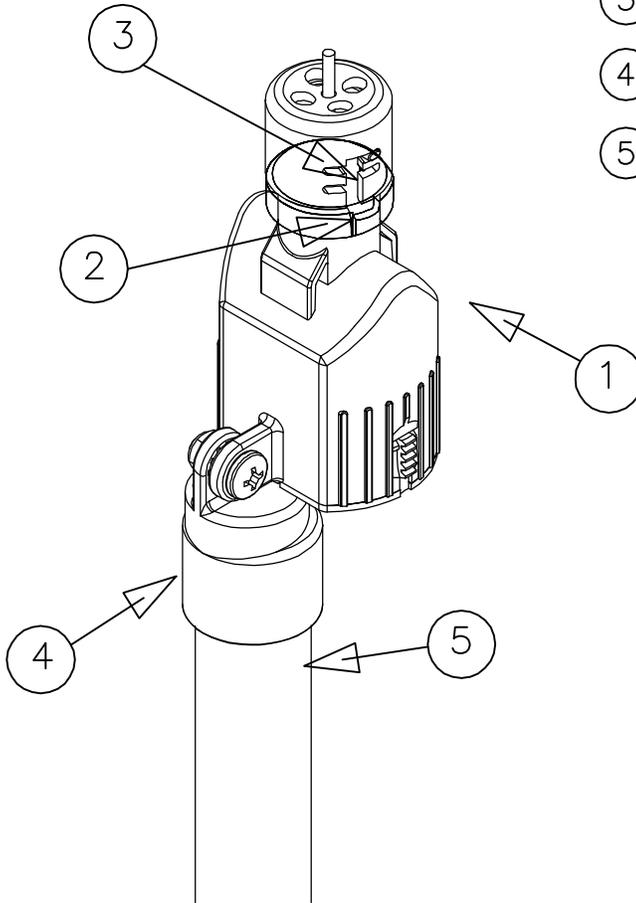

STANDARD DETAILS

RAIN SENSOR

COTTAGE GROVE, MINNESOTA

LAST REVISION:
JAN 2014

PLATE NO.
IRR-2