


FIBERGLASS HYDRANT FLAG (HYDRAFINDER) TO BE ATTACHED TO HYDRANT WITH AN EXISTING FLANGE BOLT TOWARDS THE BACK OF THE HYDRANT.



NOTES:

1. HYDRANT SHALL BE WATEROUS PACER - WB67 - 250
2. ALL D.I.P. WATERMAIN SHALL BE WRAPPED WITH 8 MIL PLASTIC INCLUDING ALL MECHANICAL JOINTS. ALL D.I.P. SHALL BE CLASS 52.
3. ALL DUCTILE IRON WATERMAIN FITTINGS SHALL BE FUSION BONDED EPOXY COATED.
4. PROVIDE ONE EXTRA HYDRANT FLAG PER HYDRANT TO THE CITY.
5. INSTALL OUT OF SERVICE TAGS TO THE HYDRANTS UNTIL TESTED AND PASSED.

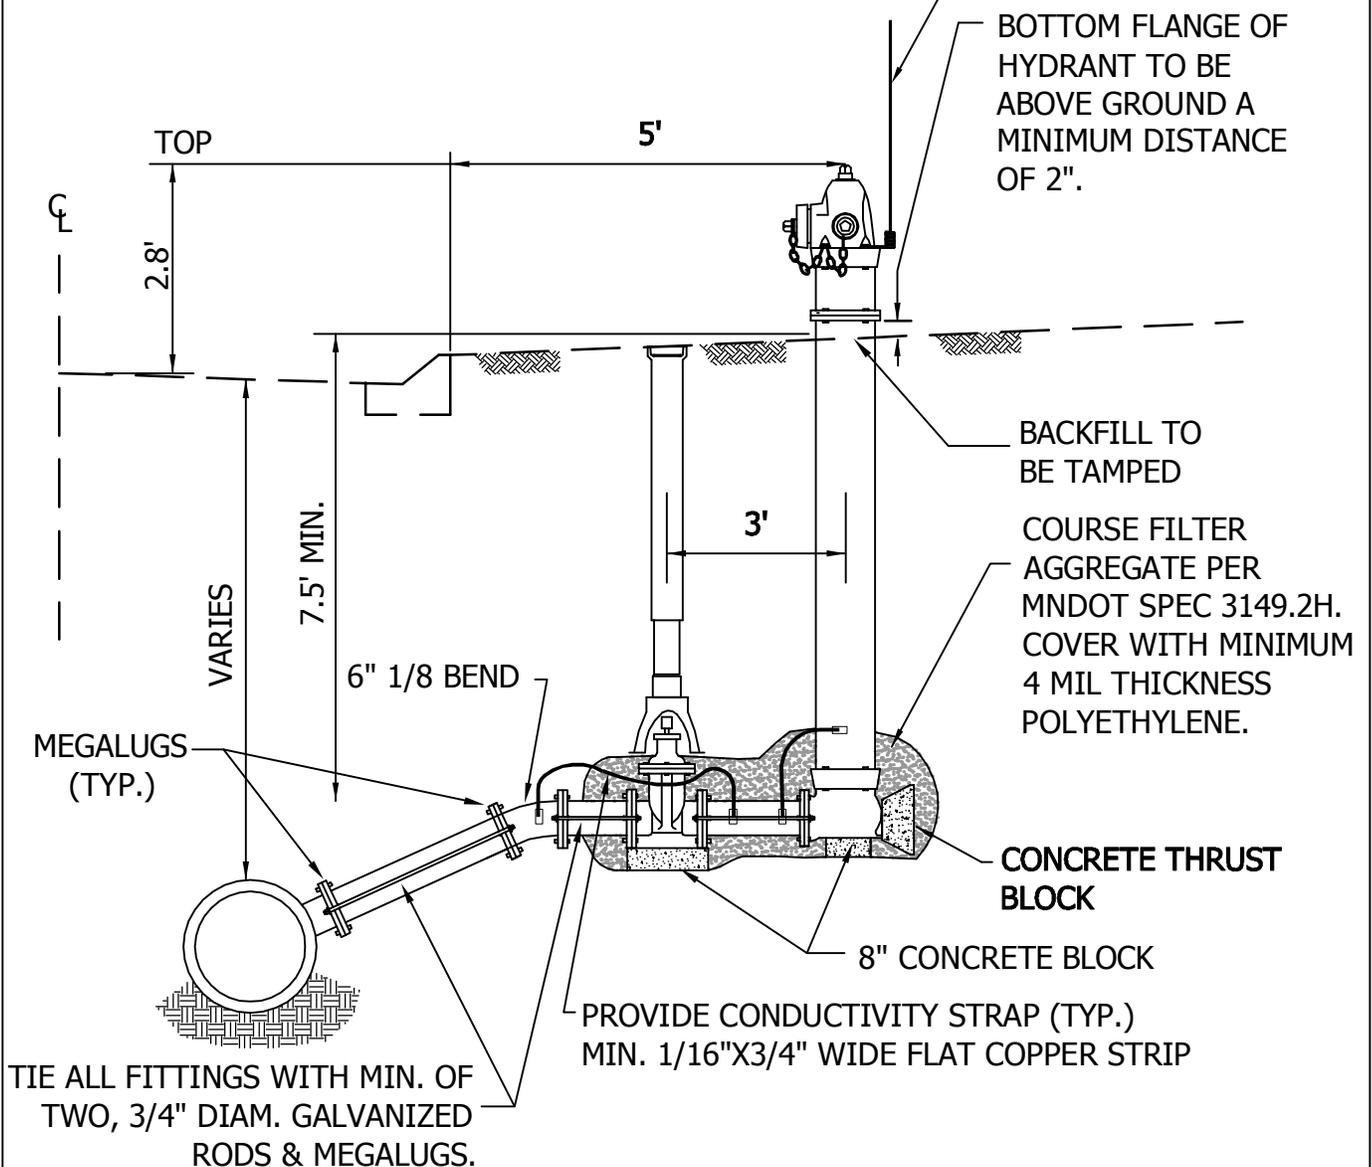

STANDARD DETAILS
HYDRANT DETAIL WITH
VERTICAL BEND

COTTAGE GROVE, MINNESOTA

LAST REVISION:
JAN 2014

PLATE NO.
WAT-2