

NEENAH CASTING R-1914-B,
 FORD A1, OR EQUAL
 INSTALLED OVER CURB STOP
 LOCATED IN DRIVEWAY OR
 PARKING LOT.

4" X 4" WOOD MARKER

PROPERTY
 LINE

GRADE

15'


12"

RESILIENT SEATED VALVE
 ANSI/AWWA C515
 WATEROUS AFC 2500 ALL
 D.I. OR APPROVED EQUAL.

PROVIDE CONDUCTIVITY
 STRAP (TYP.). MINIMUM
 1/16" X 3/4" WIDE FLAT
 COPPER STRIP.

1. 7' MINIMUM COVER
 REQUIRED OVER TOP OF
 WATER MAIN.
2. INSTALL 1" CORPORATION,
 CURB STOP AND STAND WITH
 1" COPPER PIG TAIL TO 24"
 ABOVE GRADE.
3. ALL JOINTS IN THE WATER
 LATERAL STUB SHALL BE
 RESTRAINED TO THE TEE.
4. TAP CORPORATION STOP
 IN THE CENTER OF PLUG

COURSE FILTER AGGREGATE
 PER MNDOT SPEC. 3149.2H.
 COVER WITH MINIMUM 4
 MIL. THICKNESS
 POLYETHYLENE.

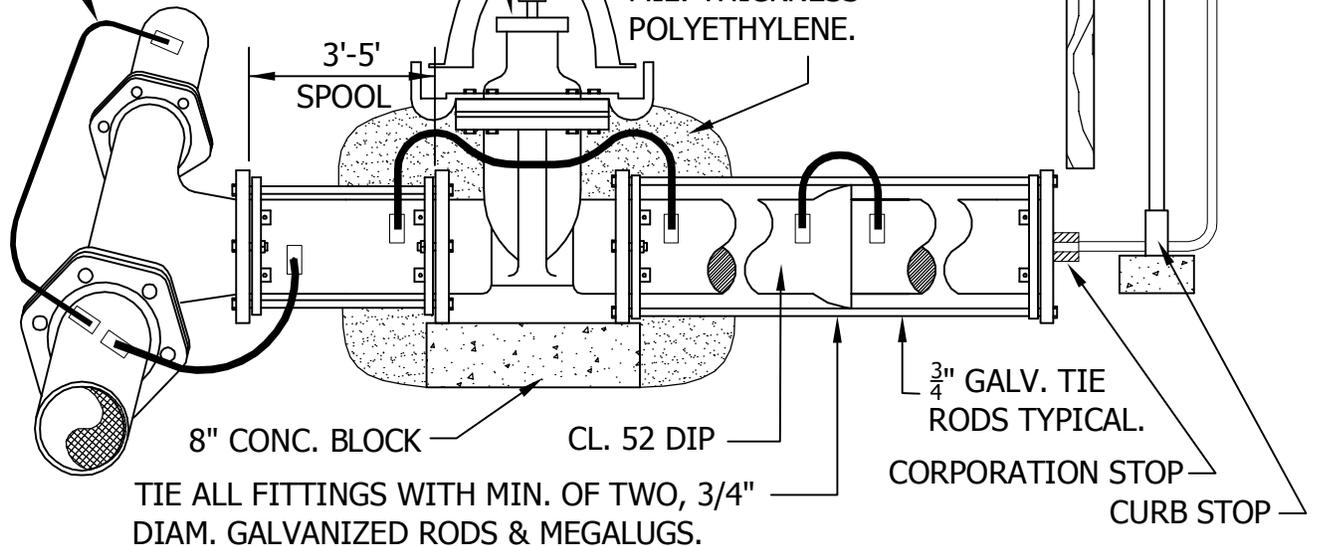

TIE ALL FITTINGS WITH MIN. OF TWO, 3/4"
 DIAM. GALVANIZED RODS & MEGALUGS.



STANDARD DETAILS
 DIP SERVICE OR DEAD END LINE

COTTAGE GROVE, MINNESOTA

LAST REVISION:
 JAN 2014

PLATE NO.
 WAT-8